

Saratoga Springs Fire Department


Saratoga Springs, NY

This report was generated on 6/23/2017 1:23:14 PM



Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 11/01/2016 | End Date: 11/30/2016

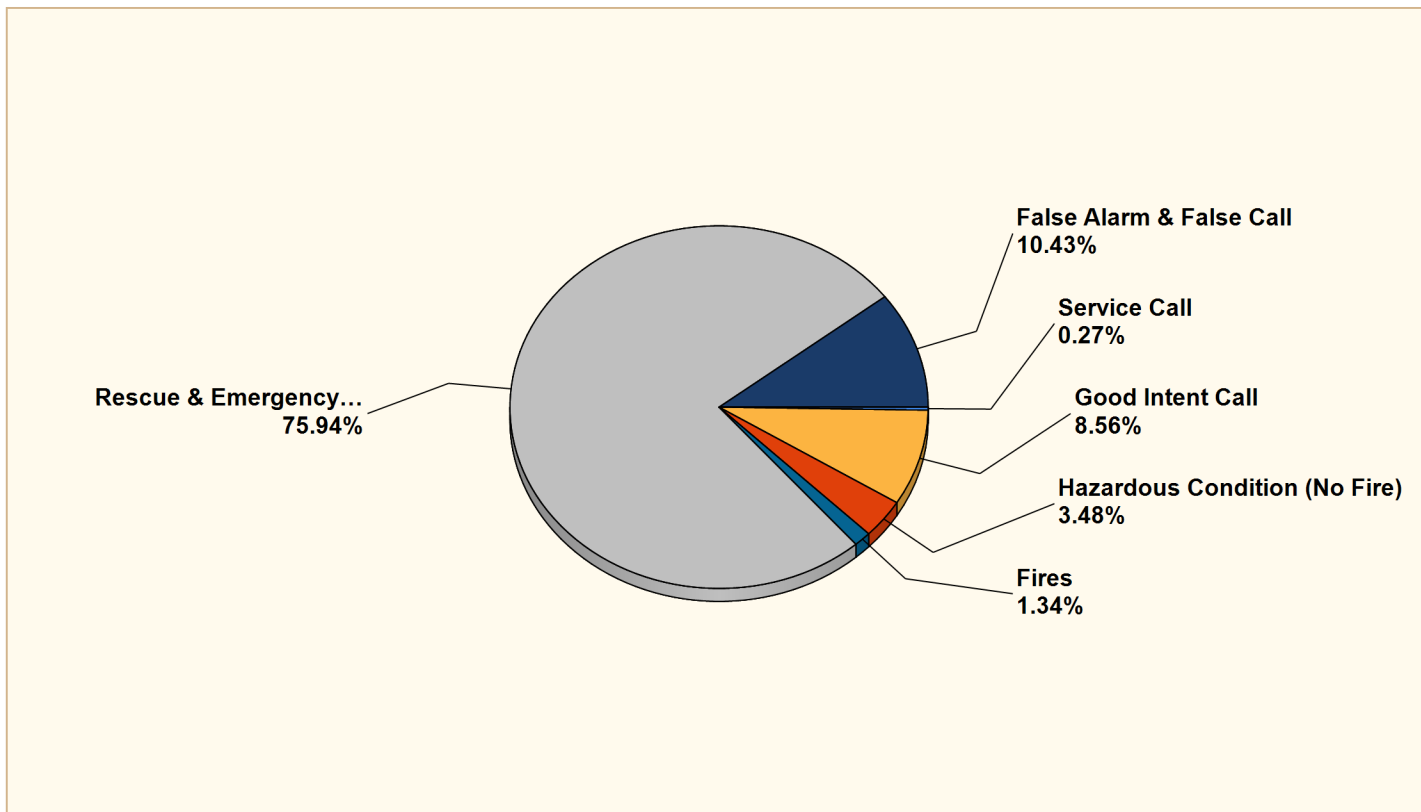

| MAJOR INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|------------------------------------|-------------|----------------|
| Fires | 5 | 1.34% |
| Rescue & Emergency Medical Service | 284 | 75.94% |
| Hazardous Condition (No Fire) | 13 | 3.48% |
| Service Call | 1 | 0.27% |
| Good Intent Call | 32 | 8.56% |
| False Alarm & False Call | 39 | 10.43% |
| TOTAL | 374 | 100.00% |

Only REVIEWED incidents included. Summary results for a major incident type are not displayed if the count is zero.

Detailed Breakdown by Incident Type

| INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|--|-------------|----------------|
| 111 - Building fire | 2 | 0.53% |
| 116 - Fuel burner/boiler malfunction, fire confined | 1 | 0.27% |
| 130 - Mobile property (vehicle) fire, other | 1 | 0.27% |
| 160 - Special outside fire, other | 1 | 0.27% |
| 321 - EMS call, excluding vehicle accident with injury | 271 | 72.46% |
| 322 - Motor vehicle accident with injuries | 11 | 2.94% |
| 323 - Motor vehicle/pedestrian accident (MV Ped) | 2 | 0.53% |
| 412 - Gas leak (natural gas or LPG) | 8 | 2.14% |
| 424 - Carbon monoxide incident | 1 | 0.27% |
| 440 - Electrical wiring/equipment problem, other | 3 | 0.80% |
| 444 - Power line down | 1 | 0.27% |
| 571 - Cover assignment, standby, moveup | 1 | 0.27% |
| 600 - Good intent call, other | 4 | 1.07% |
| 611 - Dispatched & cancelled en route | 27 | 7.22% |
| 622 - No incident found on arrival at dispatch address | 1 | 0.27% |
| 700 - False alarm or false call, other | 7 | 1.87% |
| 733 - Smoke detector activation due to malfunction | 1 | 0.27% |
| 735 - Alarm system sounded due to malfunction | 3 | 0.80% |
| 740 - Unintentional transmission of alarm, other | 8 | 2.14% |
| 743 - Smoke detector activation, no fire - unintentional | 10 | 2.67% |
| 744 - Detector activation, no fire - unintentional | 3 | 0.80% |
| 745 - Alarm system activation, no fire - unintentional | 5 | 1.34% |
| 746 - Carbon monoxide detector activation, no CO | 2 | 0.53% |
| TOTAL INCIDENTS: | 374 | 100.00% |

Only REVIEWED incidents included. Summary results for a major incident type are not displayed if the count is zero.